





1. Na crtežu i u tablici dimenzionisani su samo elementi koji se proračunavaju
2. Veza sa originalnom dokumentacijom: "ENERGOINVEST"-SARAJEVO
Crteč br: 018.1.075.00.00
018.1.075.01.00
018.1.075.03.00
018.1.075.04.00
018.1.075.05.00

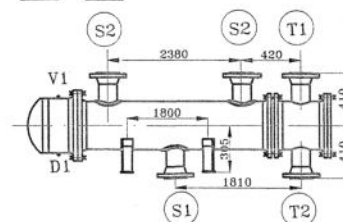

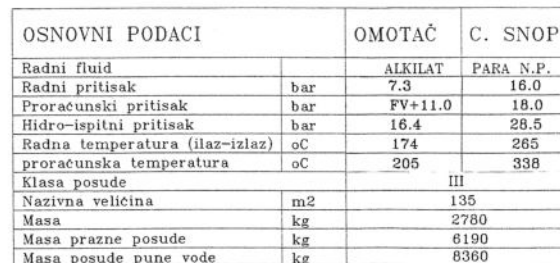

EA-2607A () () () () EA-2607B



V1	1	DN25 1"6000#				Odzracivanje	
D1	1	DN25 1"6000#				Praznjenje	
T2	1	DN80 3"300#	Sa glom. WNEF	#88.9x11.1 3"SCH160	#246/#174x9	Izlaz pare malog pritiska	
T1	1	DN150 6"300#	Sa glom. WNEF	#168.3x11 6"SCH80		Ulaz pare malog pritiska	
S2	2	DN200 8"150#	Sa glom. WNEF	#273x12.7 8"SCH80		Izlaz alkilata	
S1	1	DN200 8"150#	Sa glom. WNEF	#219x12.7 8"SCH80		Ulaz alkilata	
Ozn.	Kom.	Naz. vel.	Tip. prir.	Dtm. priključka	Dim. ojačanja	Namena	Primerba

PRIKLJUČCI I PRIRUBNICE

34	Cev	1	A106 B	ø88,9x11,1 3" SCH160	ANSI B.36.10
33	Prirubnica	1	A-105	DN80 3"300#	ANSI B.16.5
32	Natpisna ploča	1			
31	Ojačanje	1	Č.1204	ø245xø174x9	
30	Cev	3	A106 B	ø210x12,7 8" SCH80	ANSI B.36.10
29	Prirubnica	3	A-105	DN200 8"150#	ANSI B.16.5
28	Cev	1	A106 B	ø168,3x11 6" SCH80	ANSI B.36.10
27	Prirubnica	1	A-105	DN150 6"300#	ANSI B.16.5
26	Navrtka	368	Č.1530	3/4" H=B M20 H=14,4	
25	Vijak IV	44	Č.4732	3/4"-BUNC M20x88	Navoj po cel. duž
24	Vijak III	44	Č.4732	3/4"-BUNC M20x194	Navoj po cel. duž
23	Vijak II	48	Č.4732	3/4"-BUNC M20x205	Navoj po cel. duž
22	Vijak I	48	Č.4732	3/4"-BUNC M20x242	Navoj po cel. duž
21	Zaptivač V	1	Azbest obložen čeličnim limom	#3xø878/ø850	
20	Zaptivač IV	1	Azbest obložen čeličnim limom	#3xø1136/ø1109	
19	Zaptivač III	1	Azbest obložen čeličnim limom	#3xø963/ø936	
18	Zaptivač II	1	Azbest obložen čeličnim limom	#3xø963/ø936	
17	Zaptivač I	1	Azbest obložen čeličnim limom	#3xø963/ø936	
16	Prirubnica komore	1	A-105 Č.1204	ø1029/ø1067x105 ø1083x13	
15	Dance komore	1	Č.1204	ø1083x13	
14	Omotač komore	1	Č.1204	#13x271x3394	
13	Pokolopac razd. kom.	1	A-516 Gr.60	ø1036x95	
12	Prirub. razd. kom. II	1	A-105	ø10361/ø890x113	
11	Prir. razd. kom. I	1	A-105	ø1036/ø890x113	
10	Omotač razd. kom.	1	A516 Gr.60	#14x364x2840	
9	Stezni prsten	1	A-105 Č.1204	ø953/ø890x73 ø851x17	
8	Kalota	1	Č.1204	ø851x17	
7	Prirubnica	1	A-105	ø953/ø851x86	
6	Cev. ploča-pokretna	1	A-516 Gr.60	ø877x73 ø19.05x2.1x3048	
5	Cev cevnog snopa	780	A179	3/4" BWG14	
4	Cev. ploča-nepokretna	1	A-516 Gr.60	ø962x73	
3	Prirubnica tela II	1	A-105	ø1036/ø890x116	
2	Prirubnica tela I	1	A-105	ø1209/ø890x147	
1	Omotač	1	Č.1204	#12x2834x2491	

POZ.	NAZIV DELA	KOM. MATERIJAL	DIMENZIJE	MASA BR. CRT./STAN
RAZMERA	LOST: OD:	DATUM	IME	POTPIS
	Konstruis.	08.1997.	Caric D.	
	Crtao	08.1997.	Caric D.	
KOPIJA	Pregledao	08.1997.	Pavlovic D.	
	Overio	08.1997.	Dzunic M.	
		NAZIV CRTEZA		
		IZMENJIVAC TOPLOTE		
		EA - 2607 A/B		
		BROJ CRTEZA		
		EA-2607.00.00.000		
		REGISTARSKI BR. FORMATA:		
IZM.	DATUM	POTPIS		